

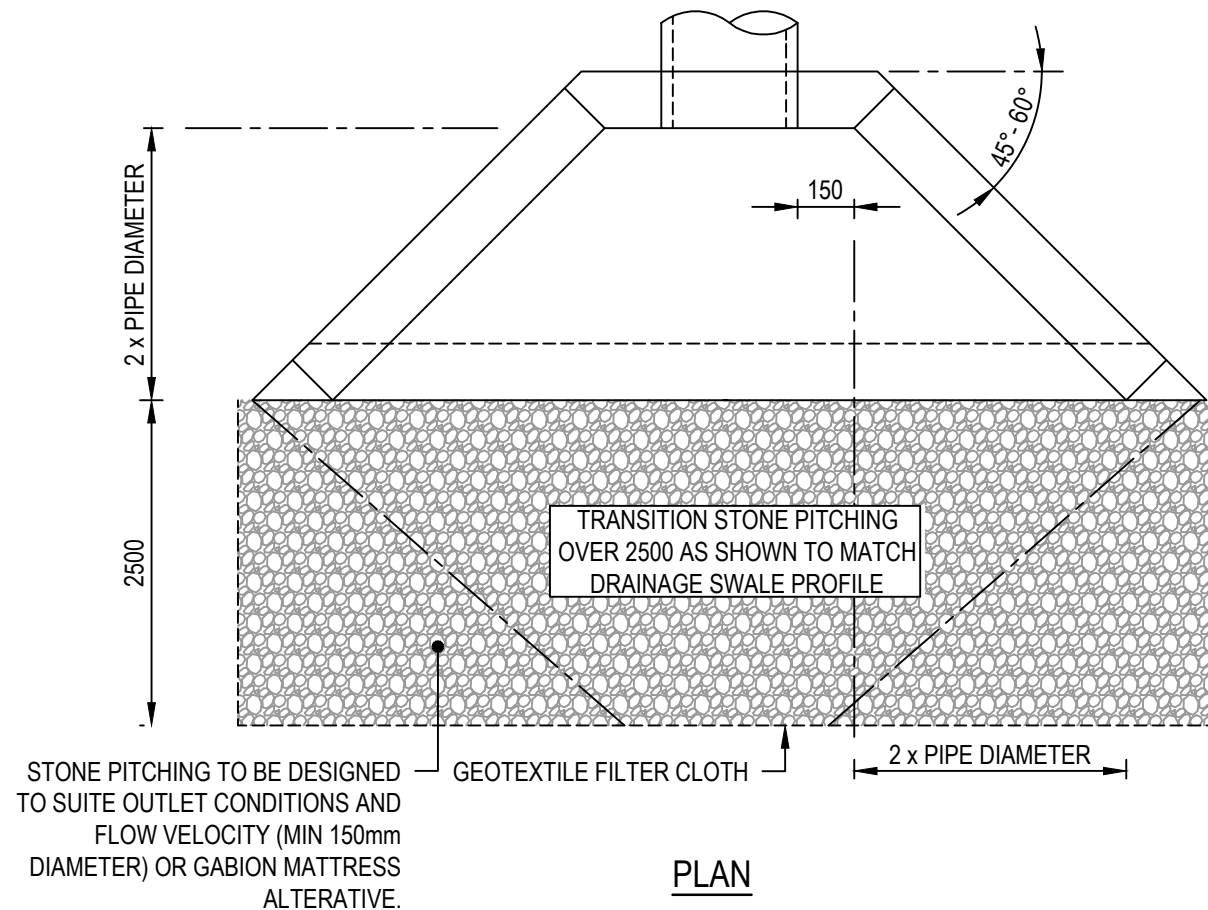
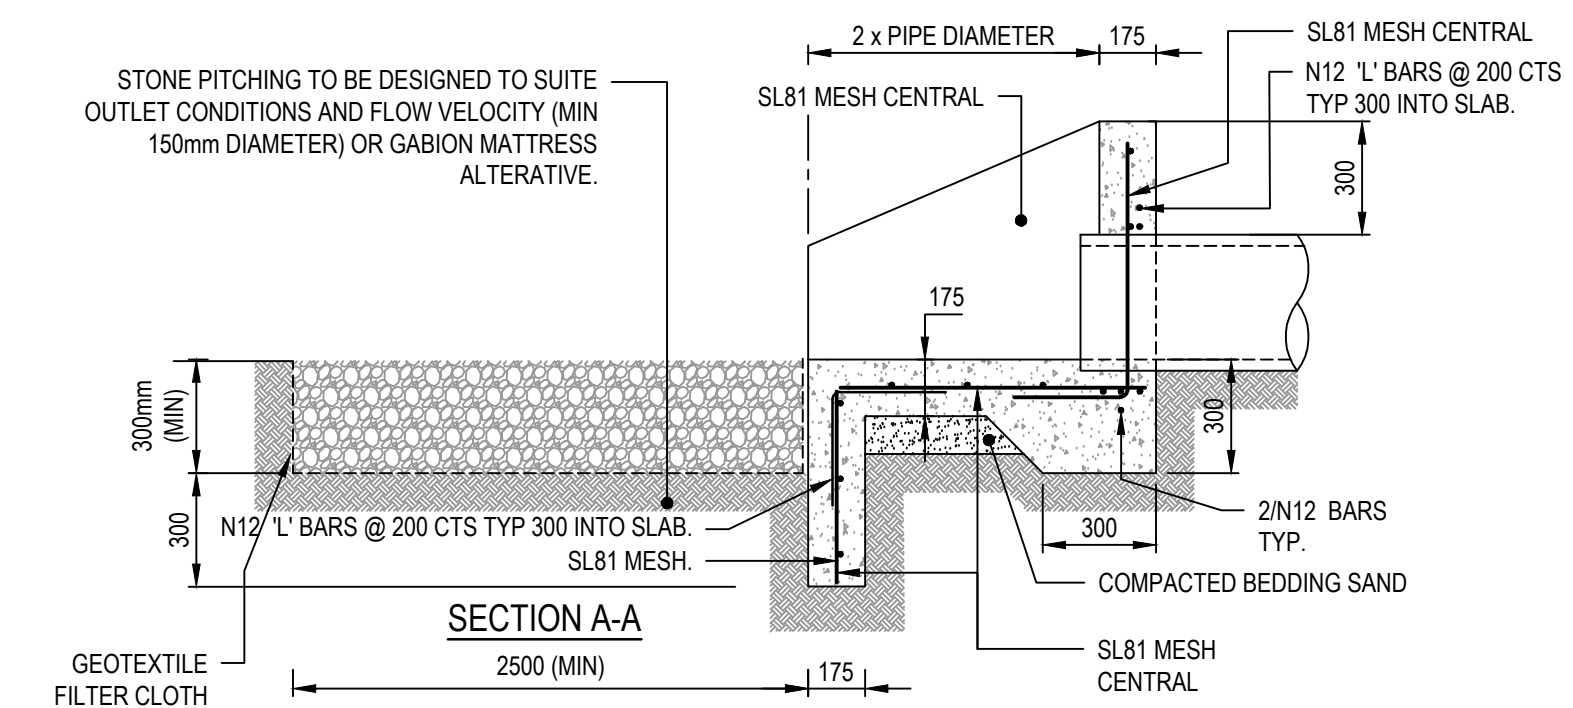


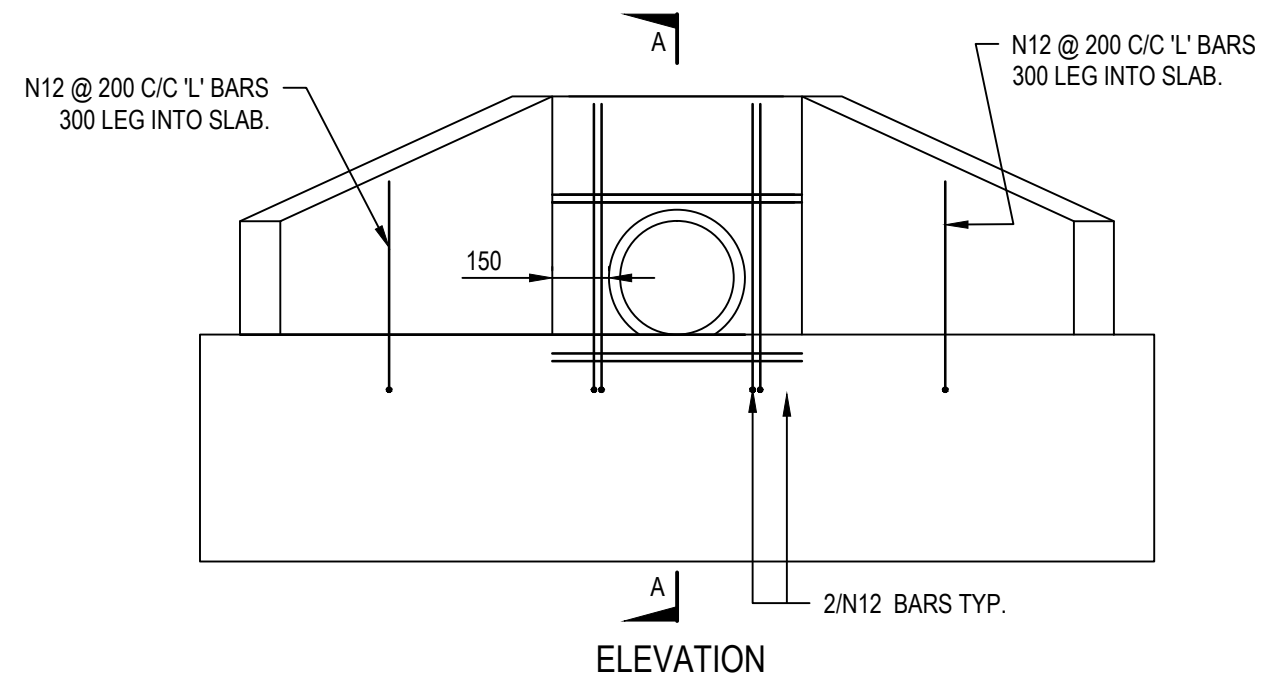

- NOTES:**
1. STREAMLINING AT UPSTREAM END ONLY
 2. SCOUR PROTECTION AT OUTLET AS SHOWN, UNLESS OTHERWISE APPROVED.
 3. APPROVED PRECAST HEADWALLS MAY BE USED AS AN ALTERNATIVE .
 4. MINIMUM COVER TO PIPES TO BE 300mm.
 5. MINIMUM FABRIC LAP 300mm
 6. CONCRETE GRADE TO BE N32, SLUMP 80mm IN ACCORDANCE WITH AS3600.
 7. MAXIMUM BATTER SLOPE ABOVE HEADWALL 1V : 2H
 8. FENCING AT TOP OF HEADWALL MAY BE REQUIRED IN LOCATION WHERE HEIGHT > 1.0m AND SITE ACCESSIBLE TO THE PUBLIC.

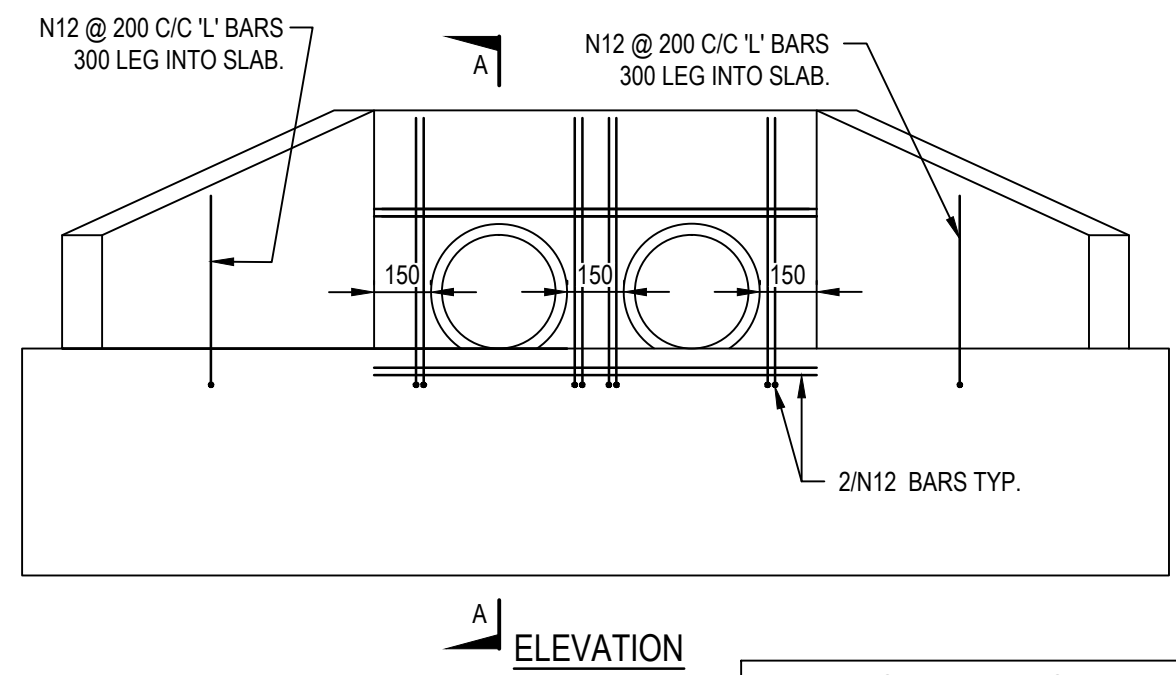

ALL MEASUREMENTS IN MILLIMETRES

						INFRASTRUCTURE GUIDELINES (SA)			
D	MINOR AMENDMENTS		06.11.2018	AF	AF	MDH	SHEET TITLE STANDARD HEADWALL FOR PIPES 450-750 DIAMETER		
C	ISSUED FOR REVIEW		17.07.2017	JZ	SGP	SH			
B	ISSUED FOR REVIEW		10.05.2016	JZ	DL	DSL			
A	ISSUED FOR REVIEW		15.03.2016	JZ	DL	DSL			
REV	DESCRIPTION		DATE	DES	DRW	APP	SCALE NTS @ A3		
THIS PROJECT HAS BEEN ASSISTED BY THE LOCAL GOVERNMENT RESEARCH AND DEVELOPMENT SCHEME AND INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALASIA						DRAWING No.		REV	
						SD 350		D	