
Appendix A
FOOTWAYS / DRIVEWAYS

1. FOOTWAYS/DRIVEWAYS

There must be a minimum of at least 1.5m of footway that is no steeper than a gradient of 1:40 which is a rise of 25mm/m (refer to example below).

Example

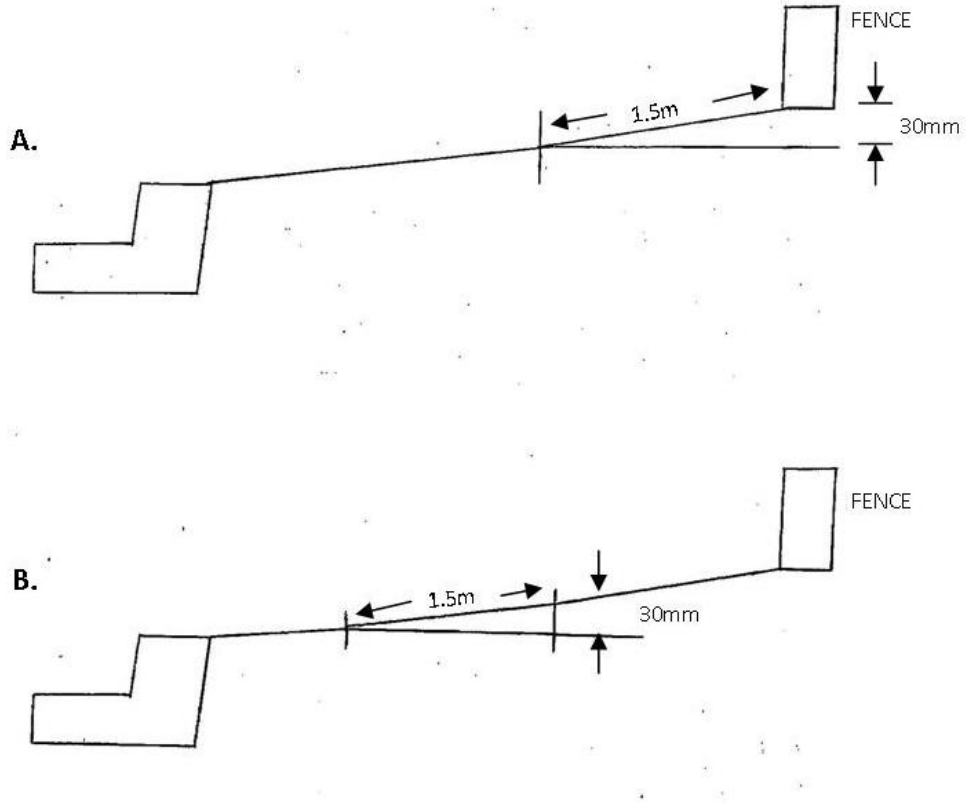

2. CONCRETE OR PAVED FOOTWAYS/DRIVEWAYS

If the applicant is constructing a concrete or paved footway or driveway, it is the responsibility of the applicant to ensure that the specifications set out in the below table are adhered to.

Land Use	Base Course	Slab Thickness	Reinforcement
Residential	75mm	100mm	SL62
Commercial (including carparks)	75mm	125mm	SL72
Industrial	75mm	150mm	SL82

3. GRASSED FOOTPATHS

The applicant is responsible for the installation or removal of a grassed footpath. If a grassed footpath is being removed and replaced with a regular dirt footpath, once the applicant has excavated the area in preparation for the material, Council can supply crusher dust for the footway area, with the applicant being responsible for the spreading and levelling of such material.

If Council is required to supply crusher dust for this purpose, the applicant must notify Council at least 48hours prior to needing it.