


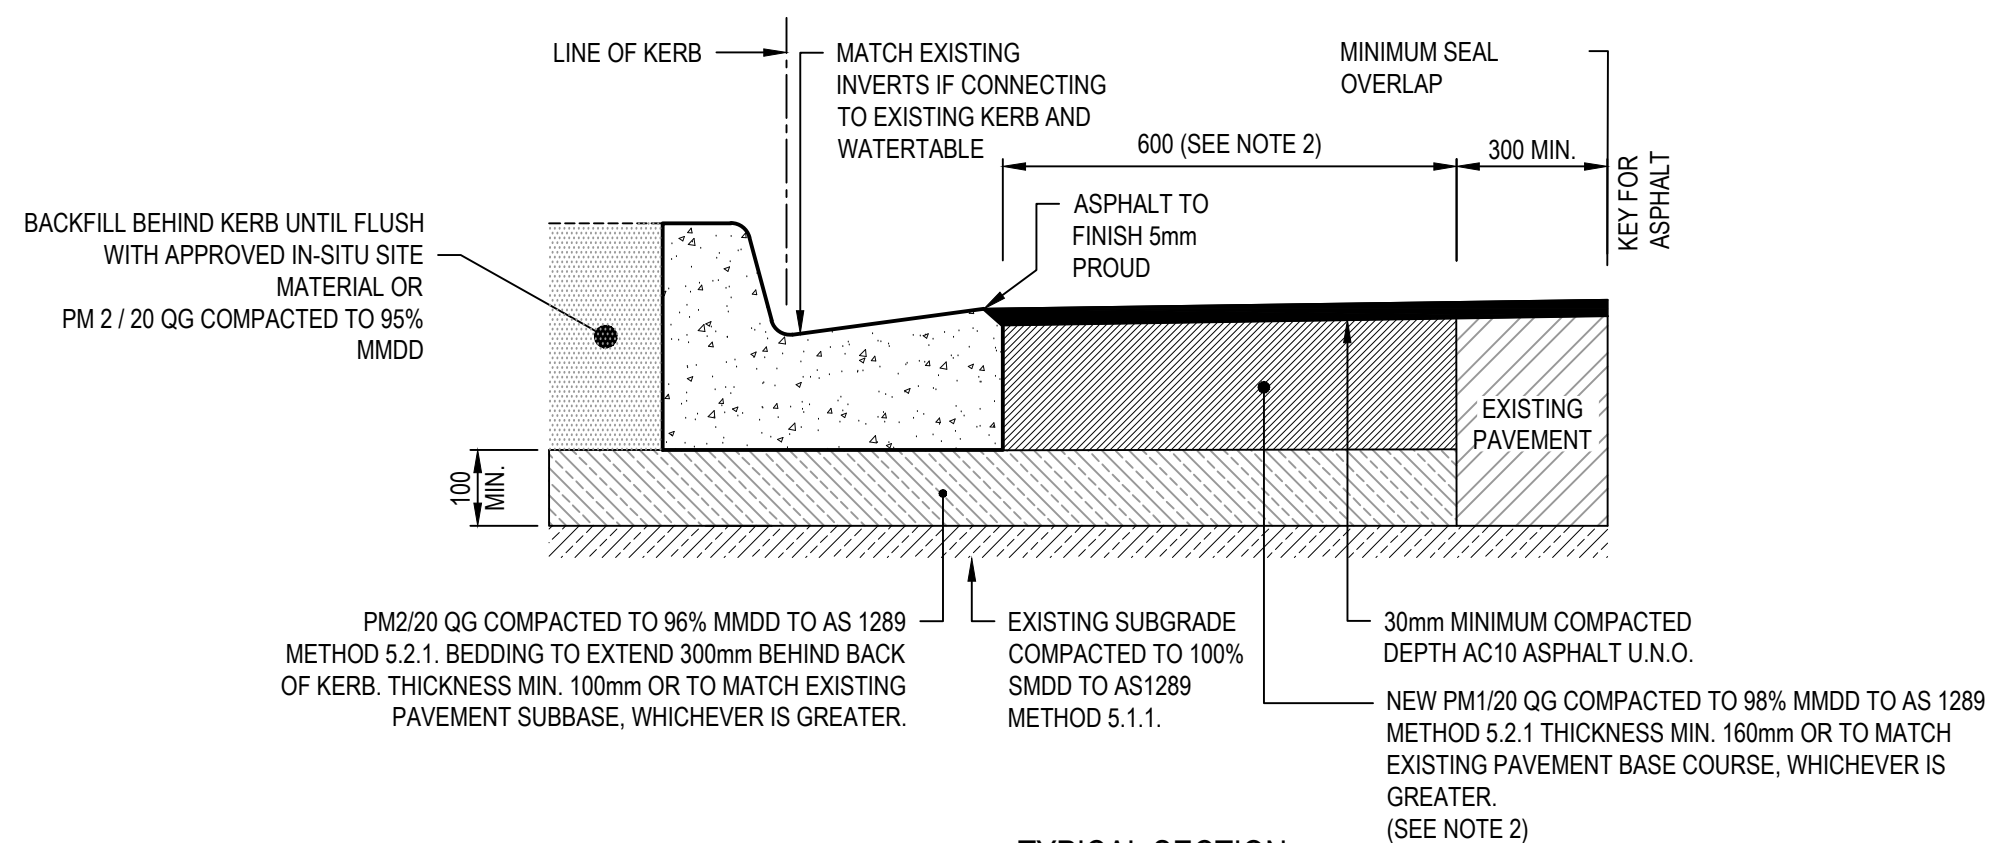

TYPICAL SECTION

ALL MEASUREMENTS IN MILLIMETRES

NOTES:

1. REFER TO SD 100 OR SD 105 FOR KERB DETAILS.
2. FOR WIDTH MINIMUM OF 100 TO 350mm USE CONTROLLED LOW STRENGTH MATERIAL (CLSM) INFILL.
3. PM 2 / 20 RG TO BE USED INSTEAD OF PM 2 / 20 QG ONLY WHEN SPECIFICALLY APPROVED BY COUNCIL.
4. REFER PAVEMENT DESIGN FOR PAVEMENT THICKNESS

						INFRASTRUCTURE GUIDELINES (SA)		SCALE 1:10 @ A3	
D	MINOR AMENDMENTS	06.11.2018	AF	AF	MDH	SHEET TITLE			
C	MINOR AMENDMENTS	18.07.2017	JZ	JC	DSL	KERB & WATERTABLE INSTALLATION			
B	ISSUED FOR REVIEW	10.05.2016	JZ	DL	DSL	ABUTTING EXISTING PAVEMENT			
A	ISSUED FOR REVIEW	15.03.2016	JZ	DL	DSL			DRAWING No.	
REV	DESCRIPTION	DATE	DES	DRW	APP			SD 110	
THIS PROJECT HAS BEEN ASSISTED BY THE LOCAL GOVERNMENT RESEARCH AND DEVELOPMENT SCHEME AND INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALASIA								REV D	