
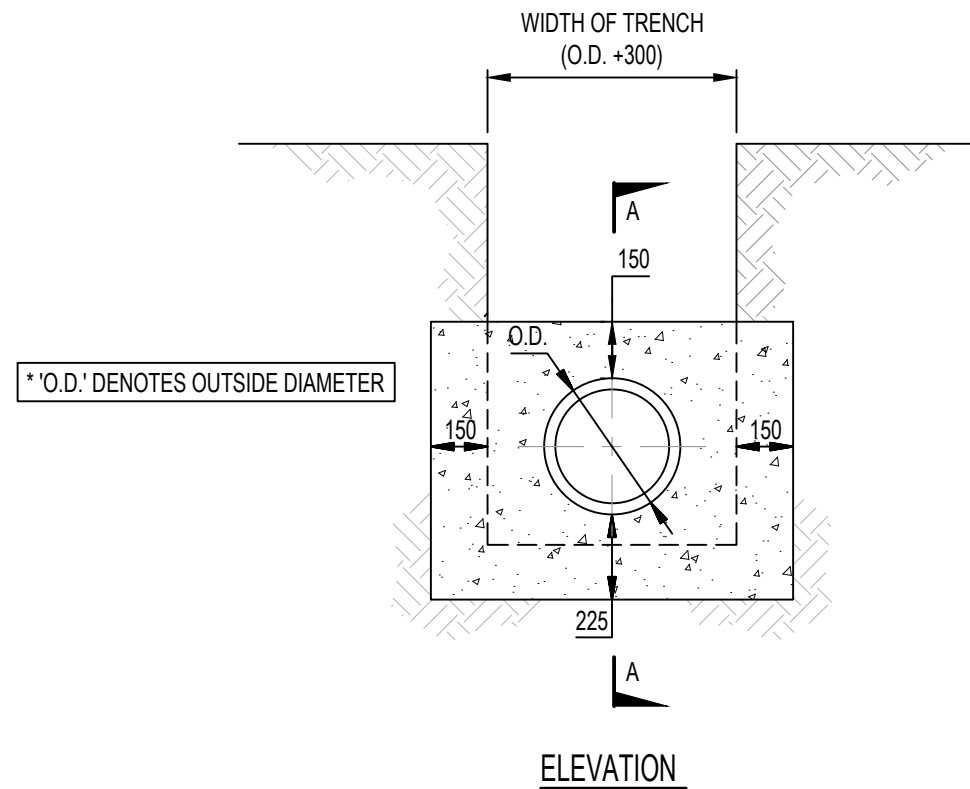


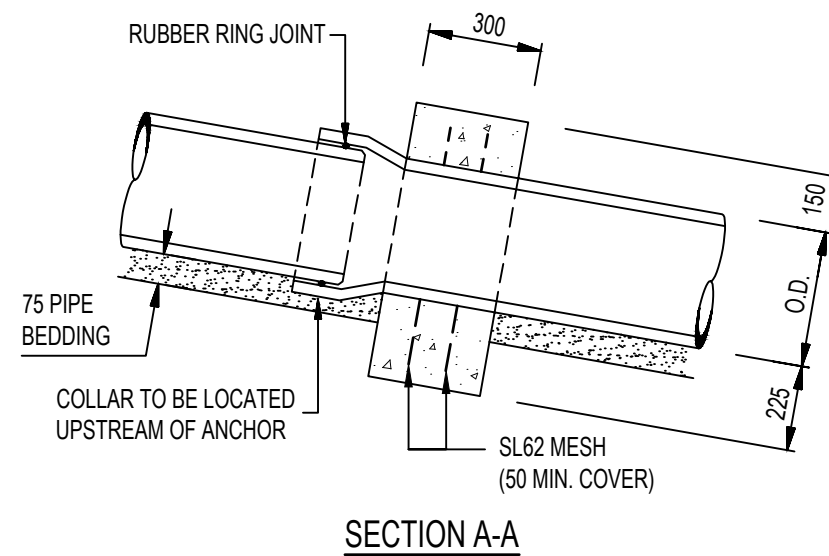

NOTES:

- FOR USE ON PIPE AT GRADES OF 1 IN 5 OR GREATER.
- TO BE CONSTRUCTED AT A MIN EVERY 5TH JOINT AND AT ALL STRUCTURES.
- CONCRETE STRENGTH TO BE 25MPa.
- RRJ PIPES TO BE USED.

ALL MEASUREMENTS IN MILLIMETRES

						INFRASTRUCTURE GUIDELINES (SA)				
						SHEET TITLE				
						STORMWATER DRAINAGE PIPE ANCHOR BLOCK				
B	ISSUED FOR REVIEW		10.05.2016	JZ	DL	DSL			SCALE	
A	ISSUED FOR REVIEW		15.03.2016	JZ	DL	DSL			NTS @ A3	
REV	DESCRIPTION		DATE	DES	DRW	APP			DRAWING No.	REV
THIS PROJECT HAS BEEN ASSISTED BY THE LOCAL GOVERNMENT RESEARCH AND DEVELOPMENT SCHEME AND INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALASIA									SD 400	B