
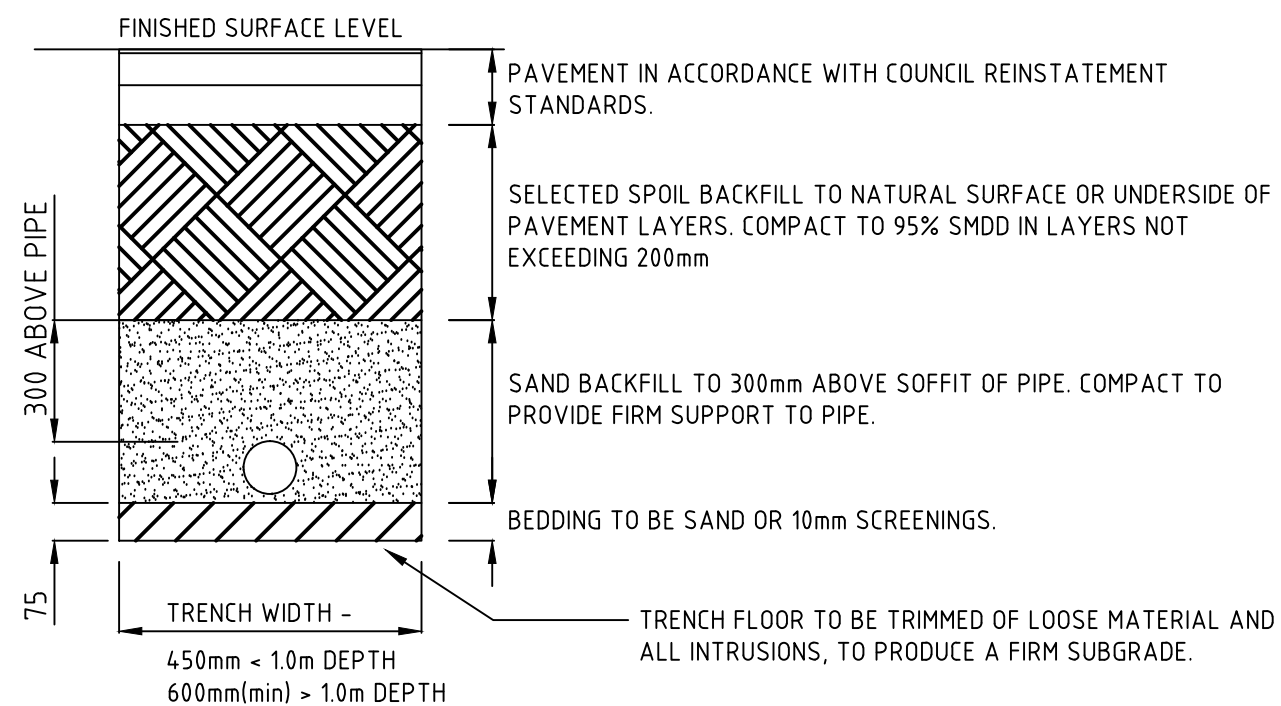


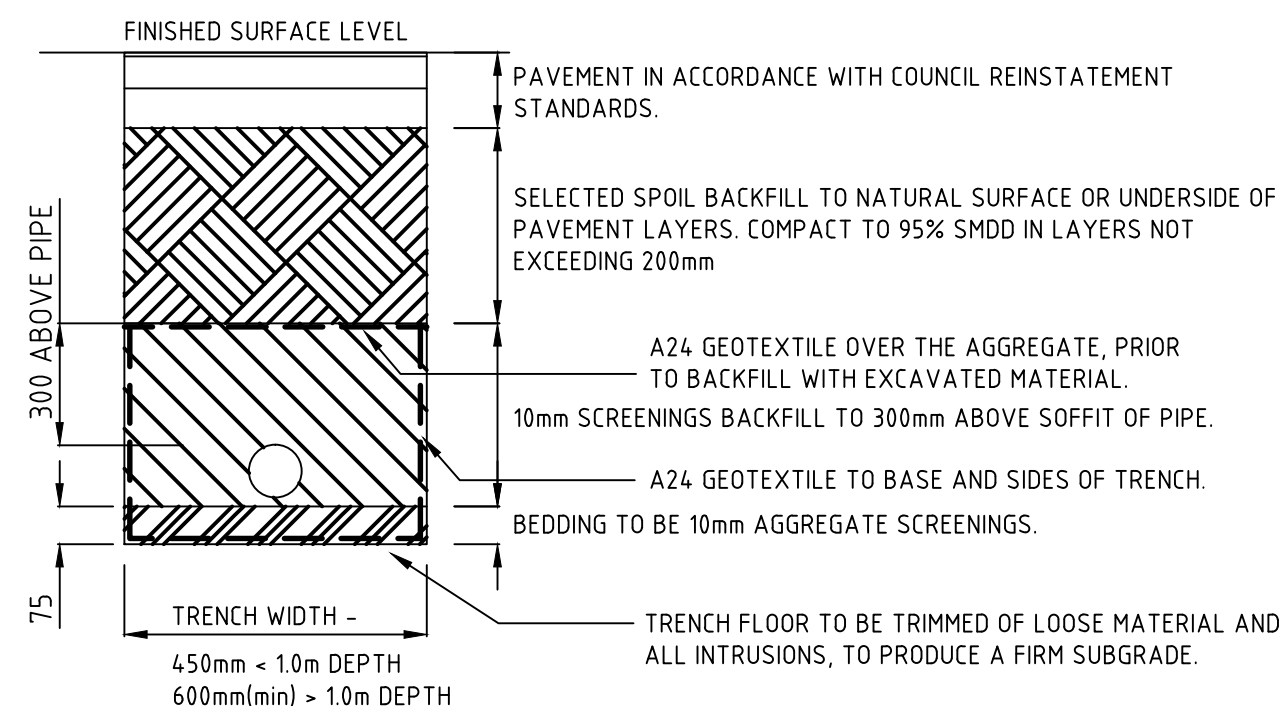

- NOTES:
1. PIPES TO BE LOCATED CENTRALLY IN TRENCH
 2. TRENCH BASE TO BE FIRM AND TO HAVE CONSTANT GRADE.
 3. UNEVEN TRENCHES ARE NOT ACCEPTABLE.
 4. DEWATER TRENCH DURING CONSTRUCTION.

ALL MEASUREMENTS IN MILLIMETRES

						INFRASTRUCTURE GUIDELINES (SA)	SHEET TITLE TRENCH AND BACKFILL DETAILS CWMS	SCALE NTS @ A3 DRAWING No. SD 700		REV B
B	MINOR AMENDMENTS	06.11.2018	AF	AF	MDH					
A	MINOR AMENDMENTS	18.07.2017	JZ	JC	DSL					
REV	DESCRIPTION	DATE	DES	DRW	APP					
THIS PROJECT HAS BEEN ASSISTED BY THE LOCAL GOVERNMENT RESEARCH AND DEVELOPMENT SCHEME AND INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALASIA										