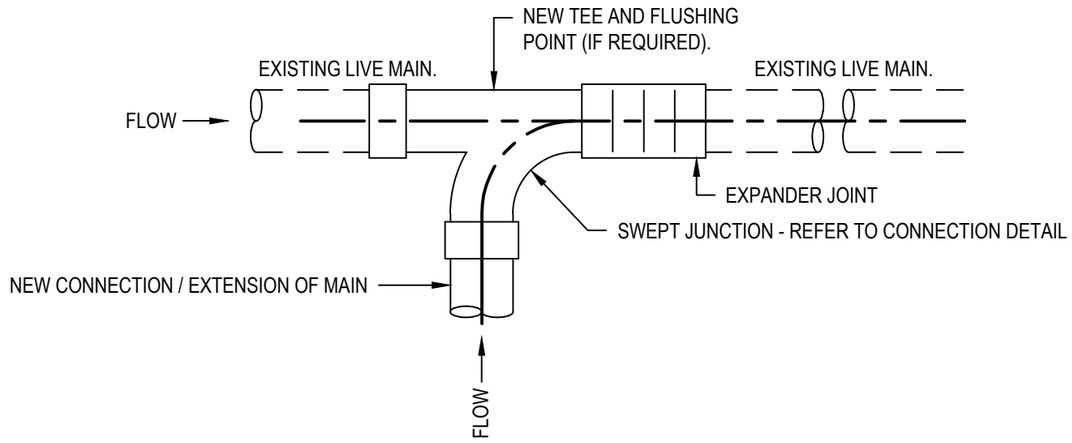


PROCEDURE:

- WORKS TO BE UNDERTAKEN BY ACCREDITED PLUMBER.
- PLUMBER TO COMPLETE AND HAVE APPROVED PERMIT TO UNDERTAKE WORKS ON COUNCIL INFRASTRUCTURE.
- PLUMBER TO MAKE ARRANGEMENTS TO MANAGE EXISTING EFFLUENT FLOW, INCLUDING ALL NECESSARY SAFETY PRECAUTIONS, TO EPA REQUIREMENTS.
- ALL MATERIALS TO BE S.A.WATER APPROVED FOR WASTEWATER.
- PRIOR TO CUTTING INTO MAIN, PLUMBER TO HAVE EXPANDER JOINT, TEE AND FLUSHING POINT (IF REQ'D.) PREPARED TO ALLOW MINIMUM DISTURBANCE TO FLOW IN EXISTING MAIN.
- INSTALL EXPANDER JOINT, TEE AND FLUSHING POINT IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS AND COUNCIL DETAILS. WRAP EXPANDER JOINT IN DENSO TAPE. ALL CUT IN'S SHALL HAVE THE DENSO TAPE COATED WITH COPPER SULPHATE AND REWRAPPED WITH DUCT TAPE.

ALL MEASUREMENTS IN MILLIMETRES

REV	DESCRIPTION	DATE	DES	DRW	APP
B	MINOR AMENDMENTS	06.11.2018	AF	AF	MDH
A	MINOR AMENDMENTS	18.07.2017	JZ	JC	DSL

THIS PROJECT HAS BEEN ASSISTED BY THE LOCAL GOVERNMENT RESEARCH AND DEVELOPMENT SCHEME AND INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALASIA

INFRASTRUCTURE GUIDELINES (SA)

SHEET TITLE
NEW CONNECTION / EXTENSION OF MAINS - CWMS

SCALE
NTS @ A3

DRAWING No.
SD 705

REV
B